



MOD : CVX/6T

Production code : BERVDI6000PRO3F-C

09/2024





Air density (γ): 1.20 kg/m³


Installation type "A": free inlet, free outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	BERVDI 6000 PRO(CL:1396)	Motor code:	201101T	Motor T.H.:	YES OUT
Test nr.:	3076	Motor power [W]:	750	Capacitor [μF]:	-
Date:	2018/11/15	Motor poles:	4	Fan max. abs. current [A]:	2,6/1,5
Power supply[V]:	230/400 3~	Mot. prot. class:	IP55	Fan max. abs. power [W]:	585
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: Not subjected to Erp Regulation

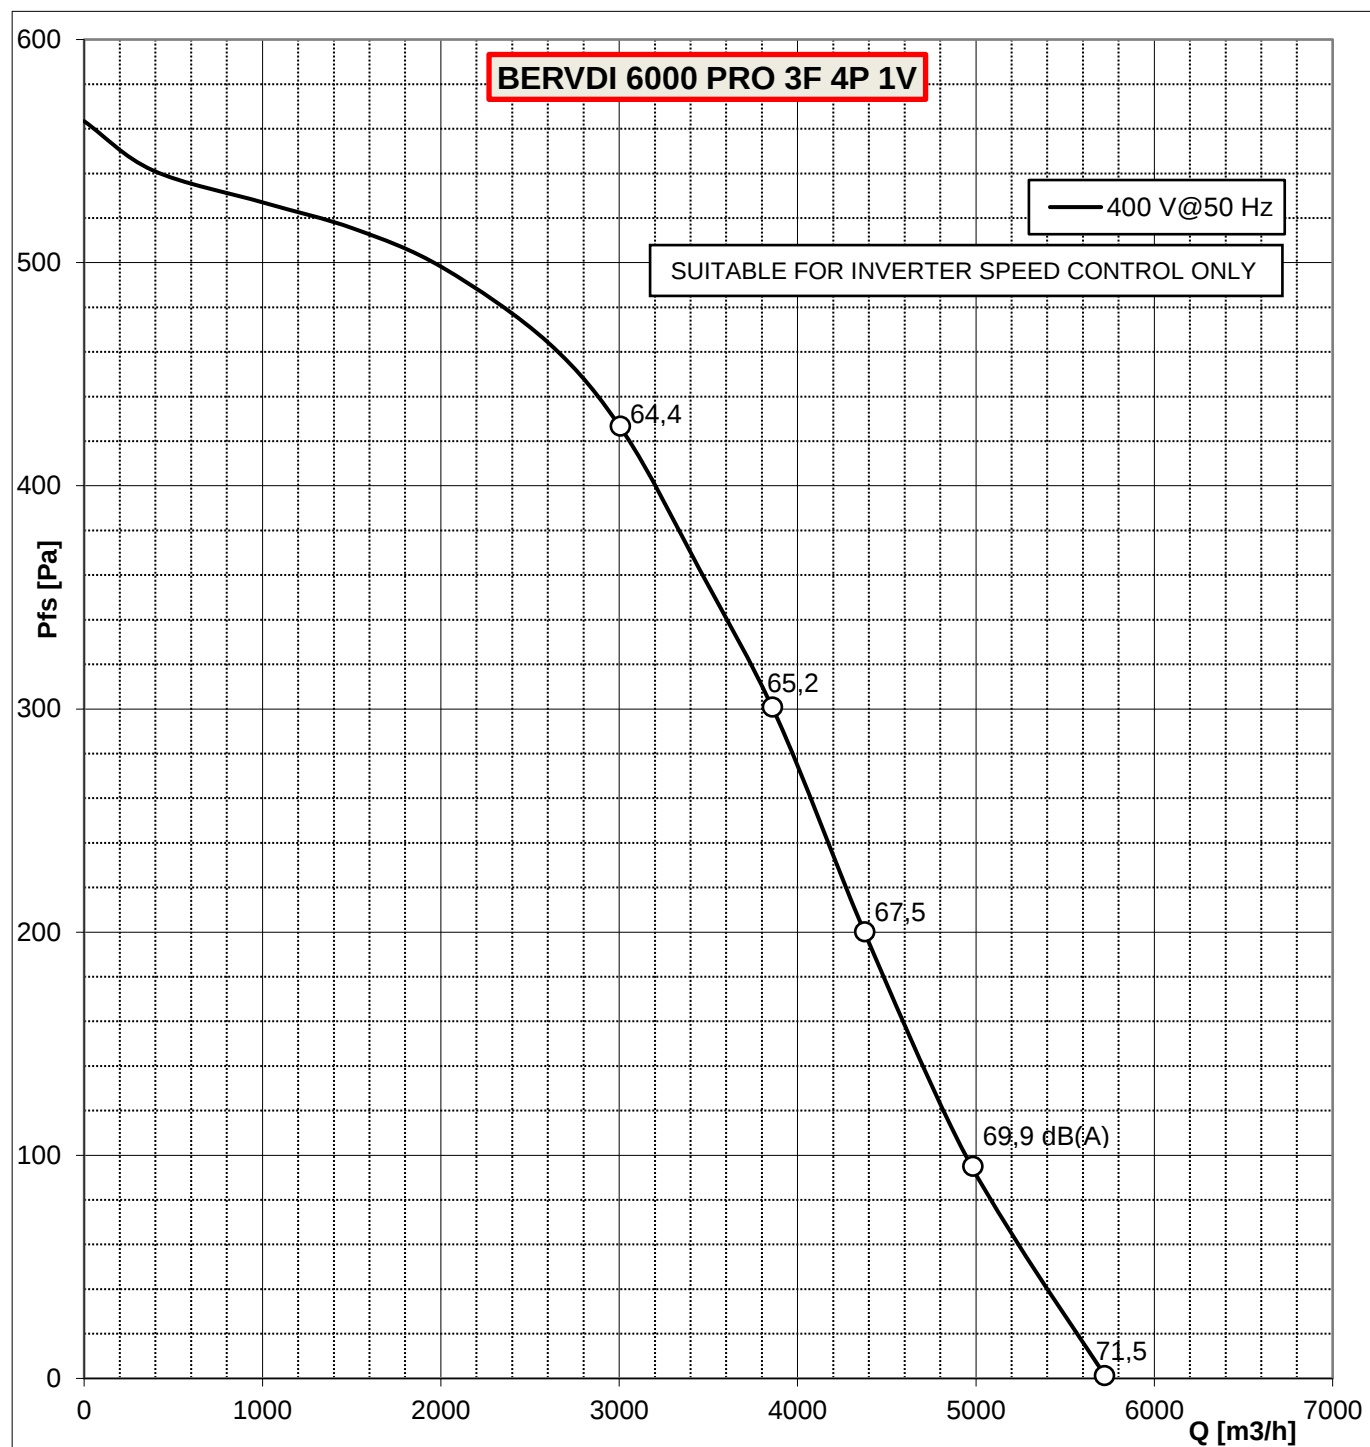



Air density (γ): 1.20 kg/m³



Installation type "A": free inlet, free outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	BERVDI 6000 PRO(CL:1396)	Motor code:	201101T	Motor T.H.:	YES OUT
Test nr.:	3076	Motor power [W]:	750	Capacitor [μF]:	-
Date:	2018/11/15	Motor poles:	4	Fan max. abs. current [A]:	2,6/1,5
Power supply[V]:	230/400 3~	Mot. prot. class:	IP55	Fan max. abs. power [W]:	585
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: Not subjected to Erp Regulation

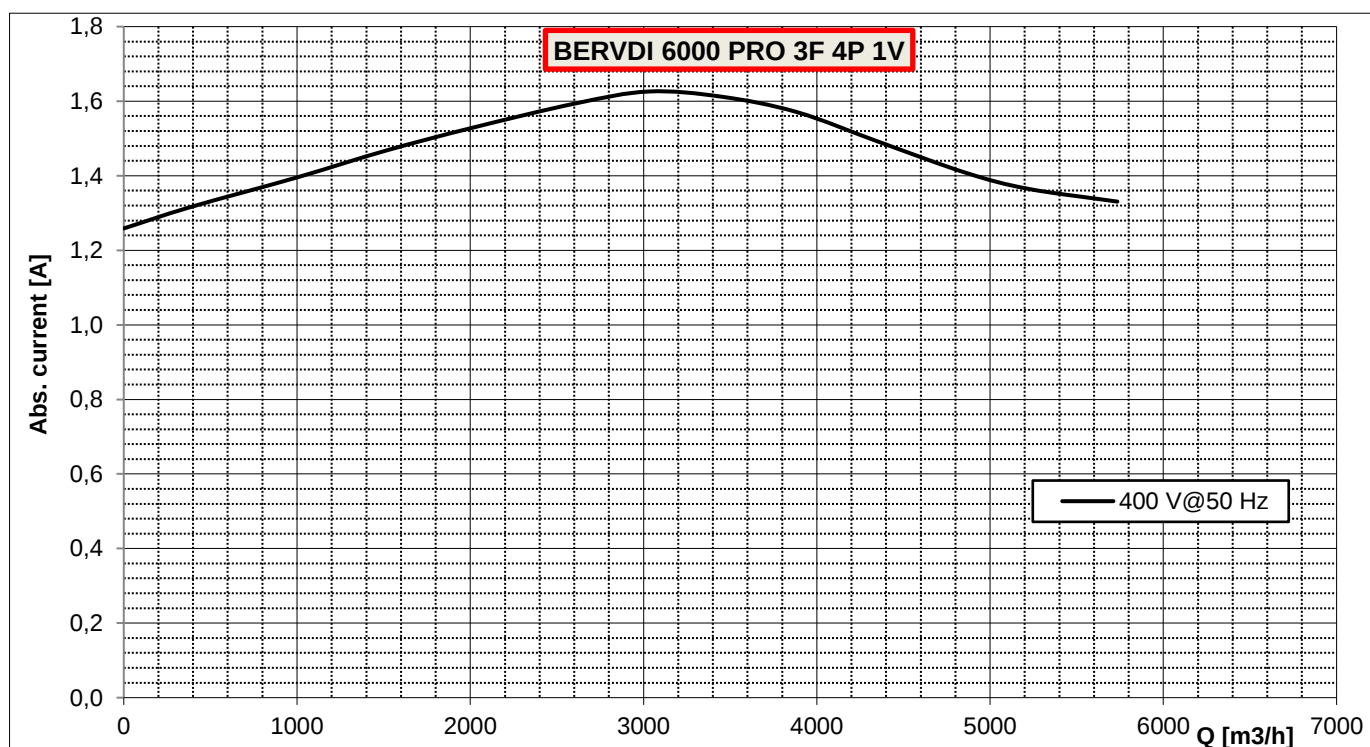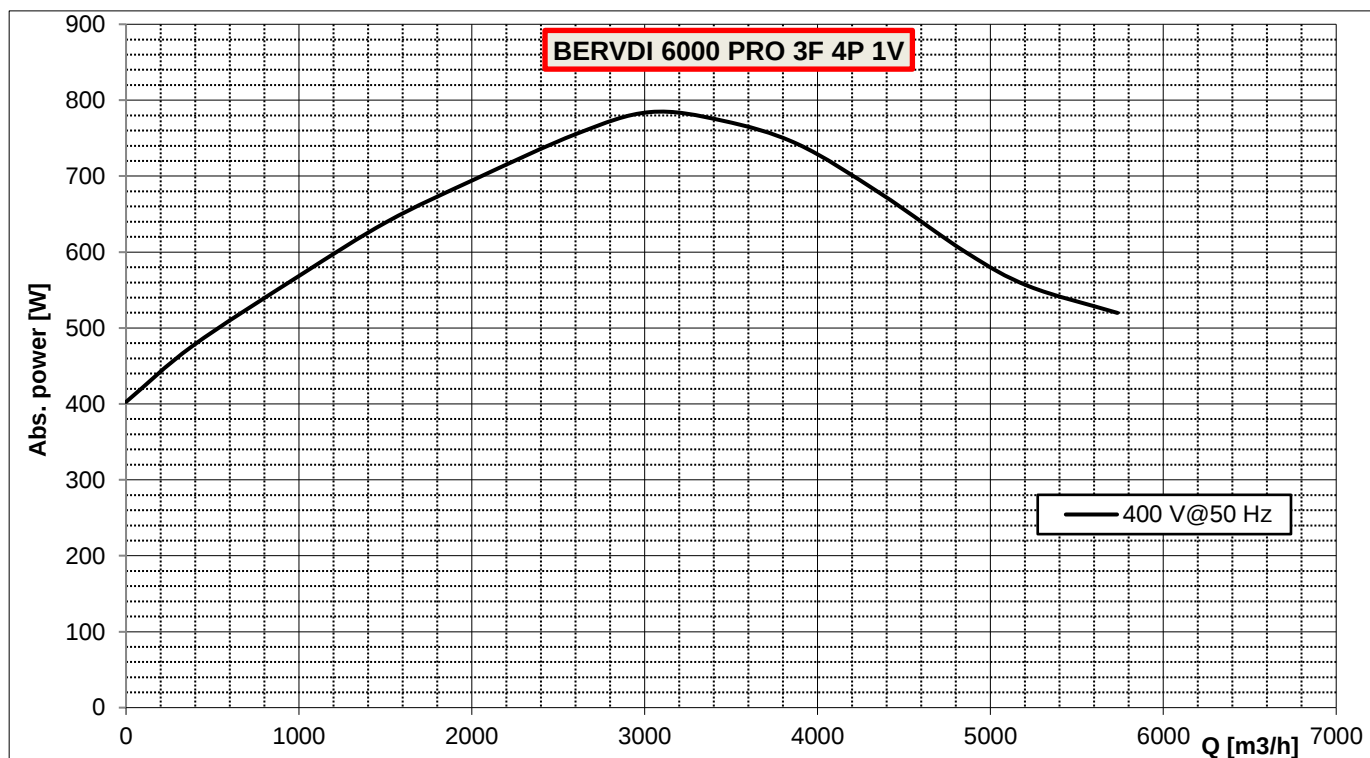



Air density (γ): 1.20 kg/m³



Installation type "A": free inlet, free outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	BERVDI 6000 PRO(CL:1396)	Motor code:	201101T	Motor T.H.:	YES OUT
Test nr.:	3076	Motor power [W]:	750	Capacitor [μF]:	-
Date:	2018/11/15	Motor poles:	4	Fan max. abs. current [A]:	2,6/1,5
Power supply[V]:	230/400 3~	Mot. prot. class:	IP55	Fan max. abs. power [W]:	585
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: Not subjected to Erp Regulation

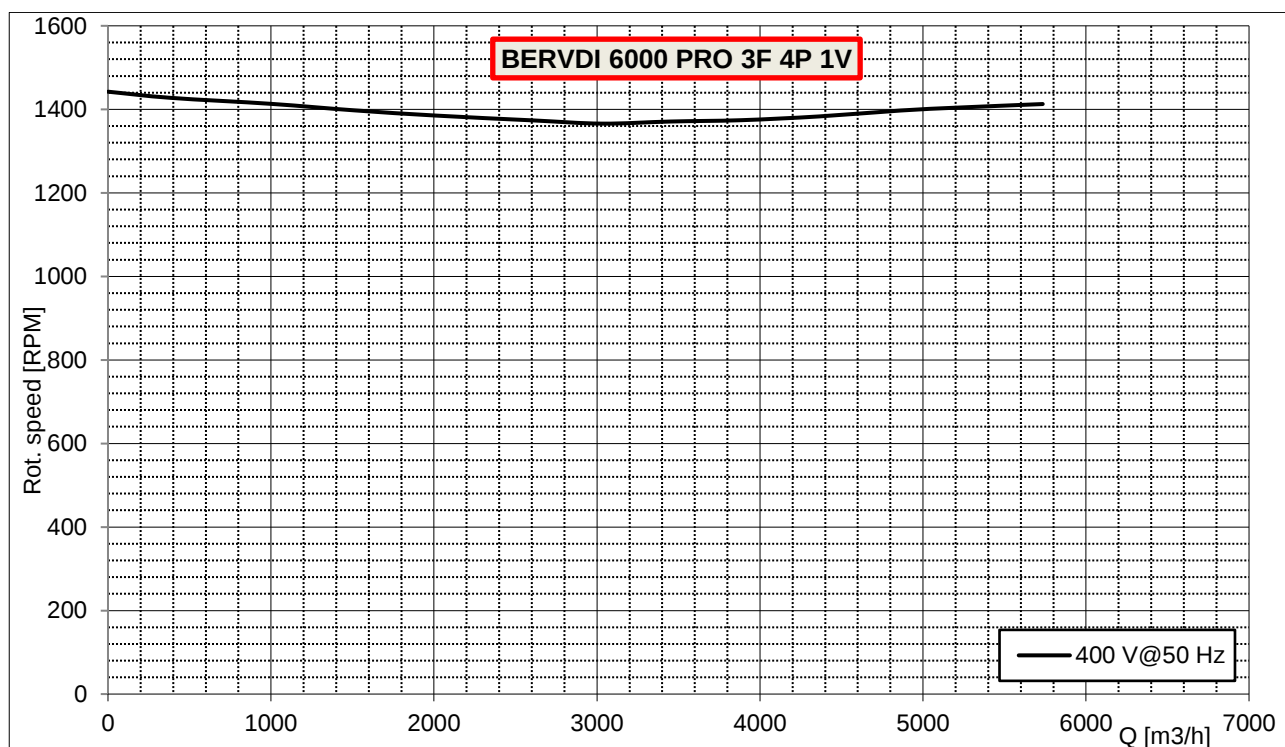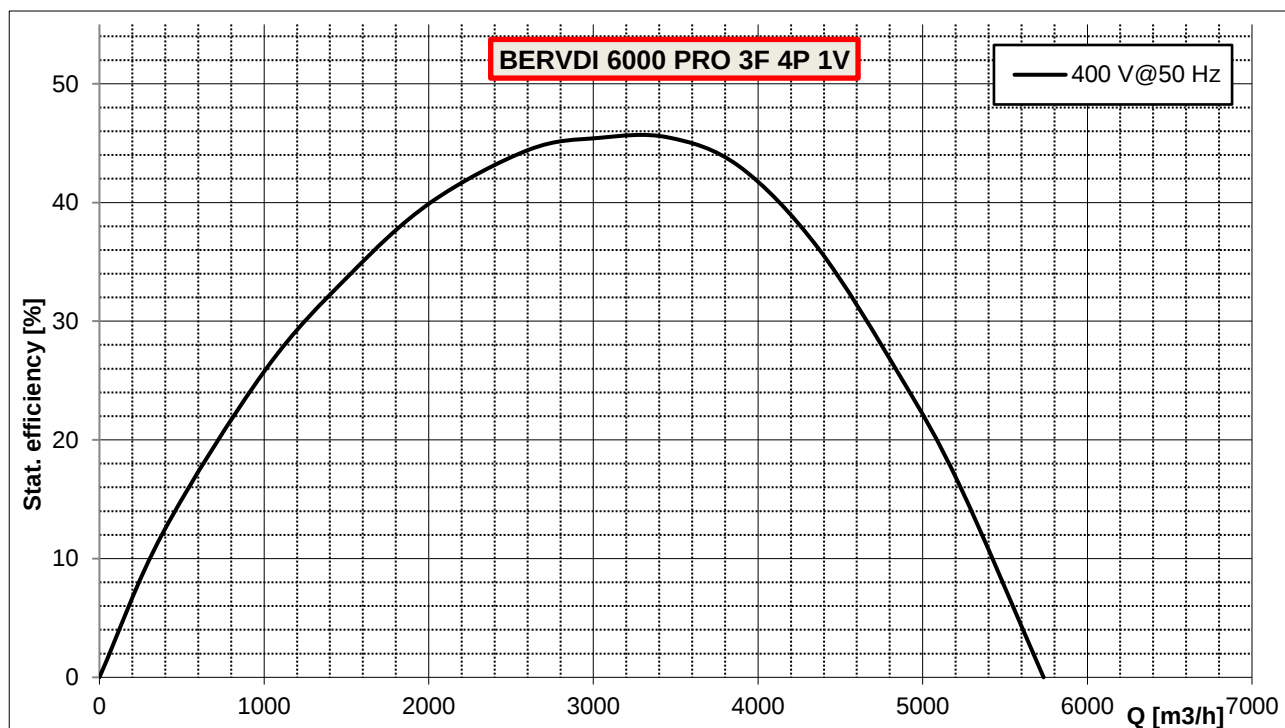



Air density (γ): 1.20 kg/m³

Installation type "A": free inlet, free outlet


12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	BERVDI 6000 PRO(CL:1396)	Motor code:	201101T	Motor T.H.:	YES OUT
Test nr.:	3076	Motor power [W]:	750	Capacitor [μF]:	-
Date:	2018/11/15	Motor poles:	4	Fan max. abs. current [A]:	2,6/1,5
Power supply[V]:	230/400 3~	Mot. prot. class:	IP55	Fan max. abs. power [W]:	585
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: Not subjected to Erp Regulation

Setup for unit noise test

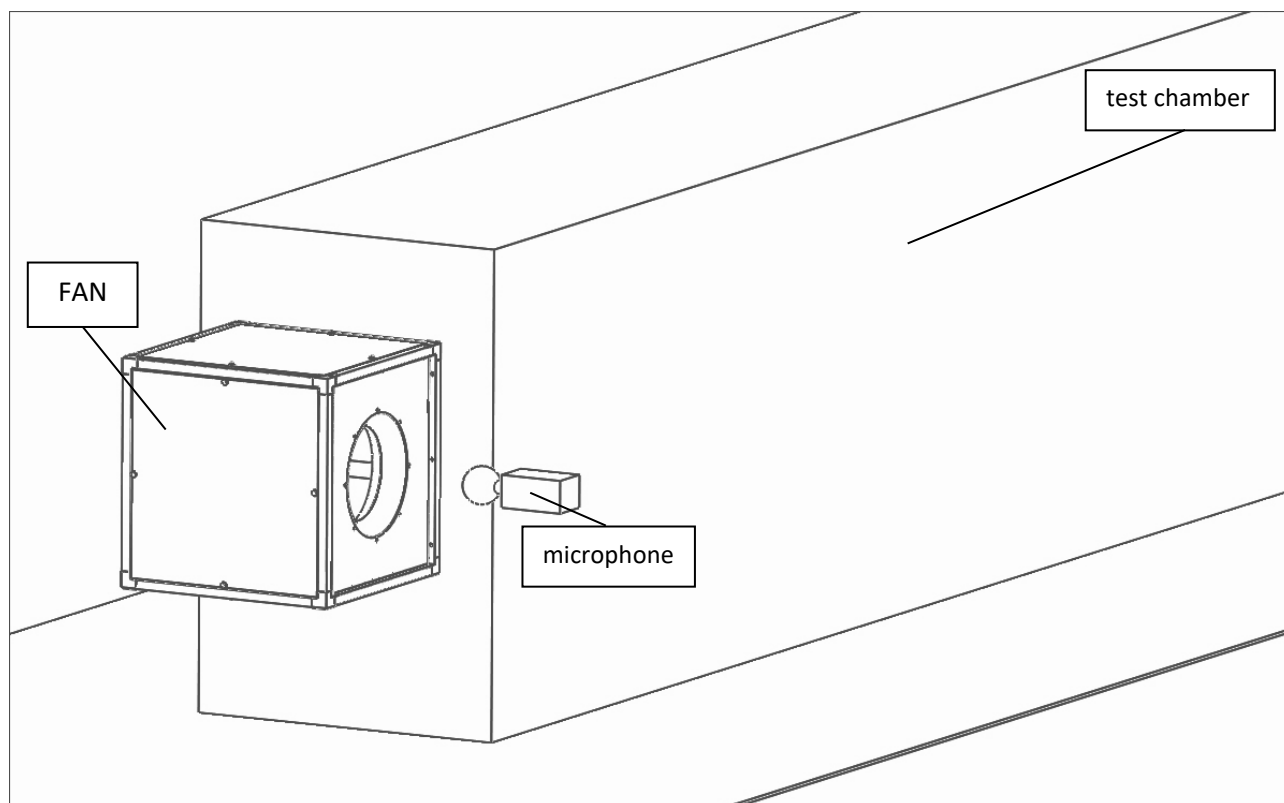

Noise test setup is according to ISO 3746:2011 Standard.

A microphone, placed at 1 meter from the air inlet and 1 meter from the ground, gets the sound pressure levels in different unit operating conditions.

Test data are then mathematically revised in order to get the A-weighted free-field total sound pressure levels Lp(A) of the unit.

The Lp(A) value in dB(A) is available on CMC documentation.

Add 11 dB(A) to the sound pressure level Lp(A) value to get the correspondent sound power level Lw(A).

CI RISERVIAMO A TERMINI DI LEGGE LA PROPRIETÀ DI QUESTO DISEGNO
CON IL DIVIETO DI RIPRODURLO O RENDERLO COMUNQUE NOTO
A TERZI CONCORRENTI O A TERZI SENZA LA NOSTRA APPROVAZIONE.

ACCORDING TO THE LAW RESERVE THE RIGHT OF OWNERSHIP OF THIS DRAWING
WITH PROHIBITION TO EITHER REPRODUCE IT OR NOTIFY IT
TO COMPETITORS AND THIRD PARTIES WITHOUT AUTHORISATION

