

02/2023


Mod: SDE/XC-22

Production code: 228965-SPECIALE



A - Included Components

1

6-10 GRIDS



20 GRIDS



A



IMPORTANT: For compliance with UK Water Supply (Water Fittings) Regulations the installer technician must provide a WRAS approved double check valve for each water connection, or other device no less effective that provides back-flow protection of at least fluid category three.

B - H2O Connections

2




⚠ PRESSURE
100 – 600 kPa
(1,0 – 6,0 bar / 14,5 – 87 psi)

- min 2 l/min - max 10 l/min



Water Treatment System

- min 2,95 l/min - max 5,75 l/min


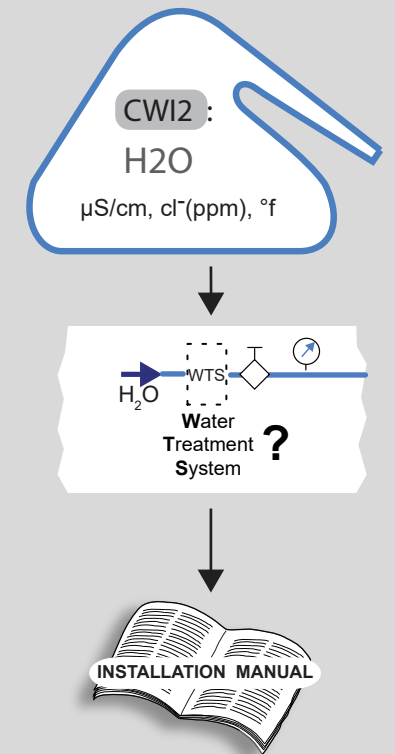
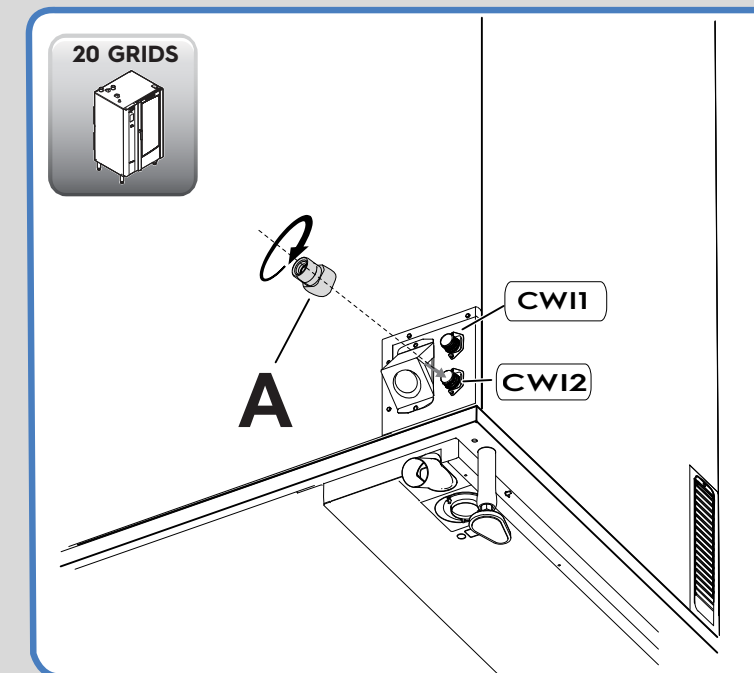
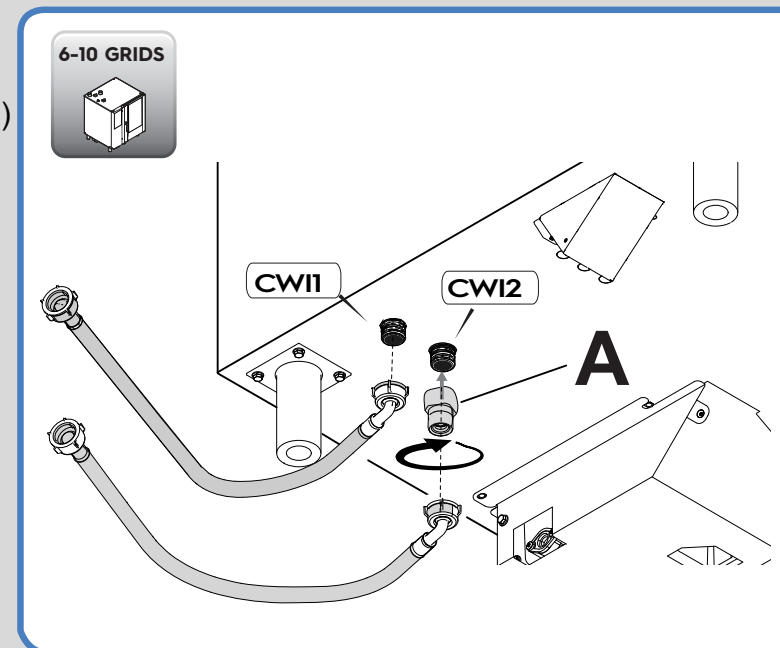


C - Drain Connection

3


Drain Hose ø50mm
smooth fitting

AUS only: The appliance shall be drained to a certified waste trap positioned at the drainage system connection point.

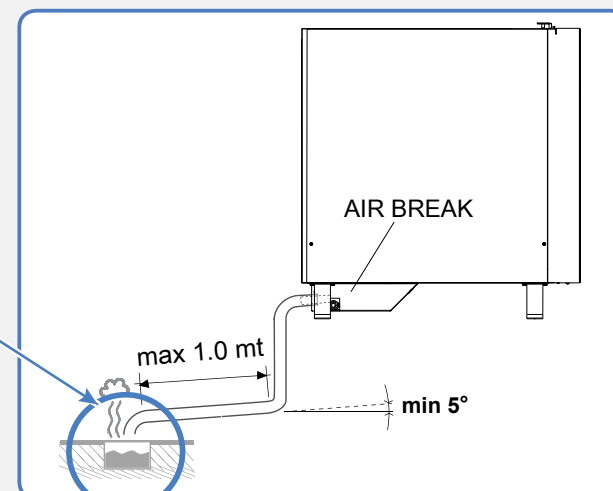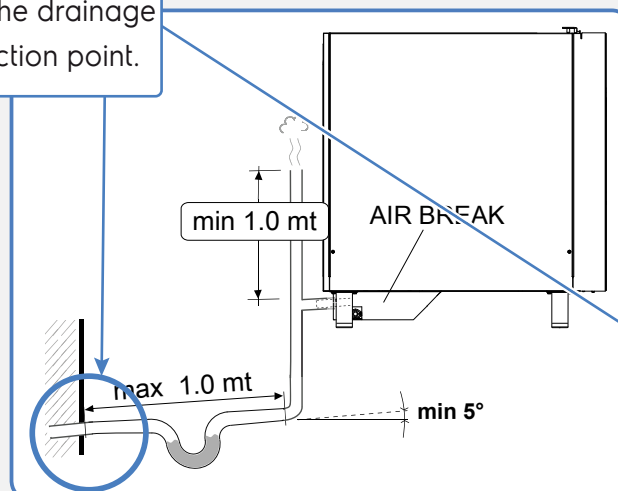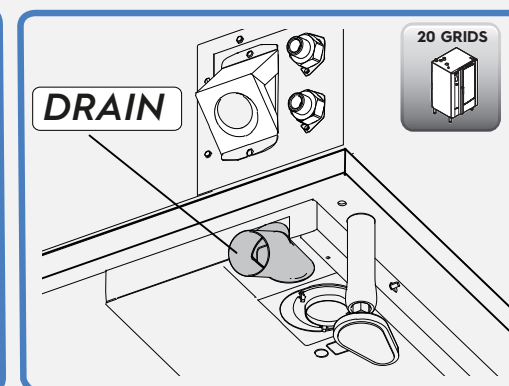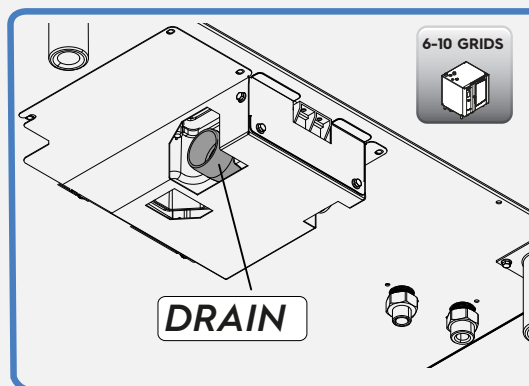

(GAS OVEN ONLY)


4

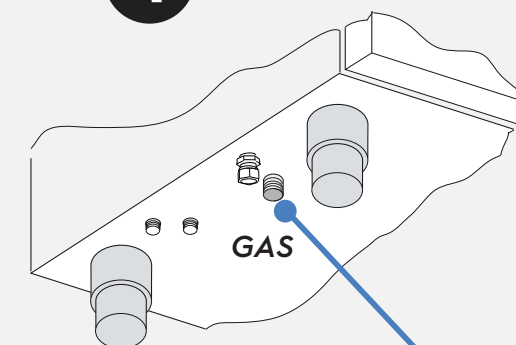


Ø1" - 20 GRIDS 1/1
Ø1" - 20 GRIDS 2 /1
Ø1" - 10 GRIDS 2/1

Ø1/2" - 6 GRIDS 1/1
Ø1/2" - 6 GRIDS 2 /1
Ø1/2" - 10 GRIDS 1/1

GAS PRESSURE




GAS PRESSURE
REGULATOR

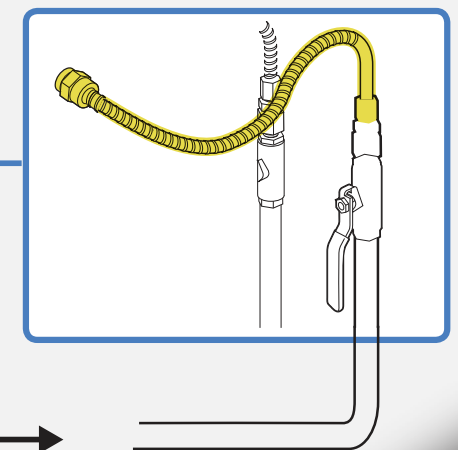


GAS INLET →

D - Gas Connections


E - Electrical connections

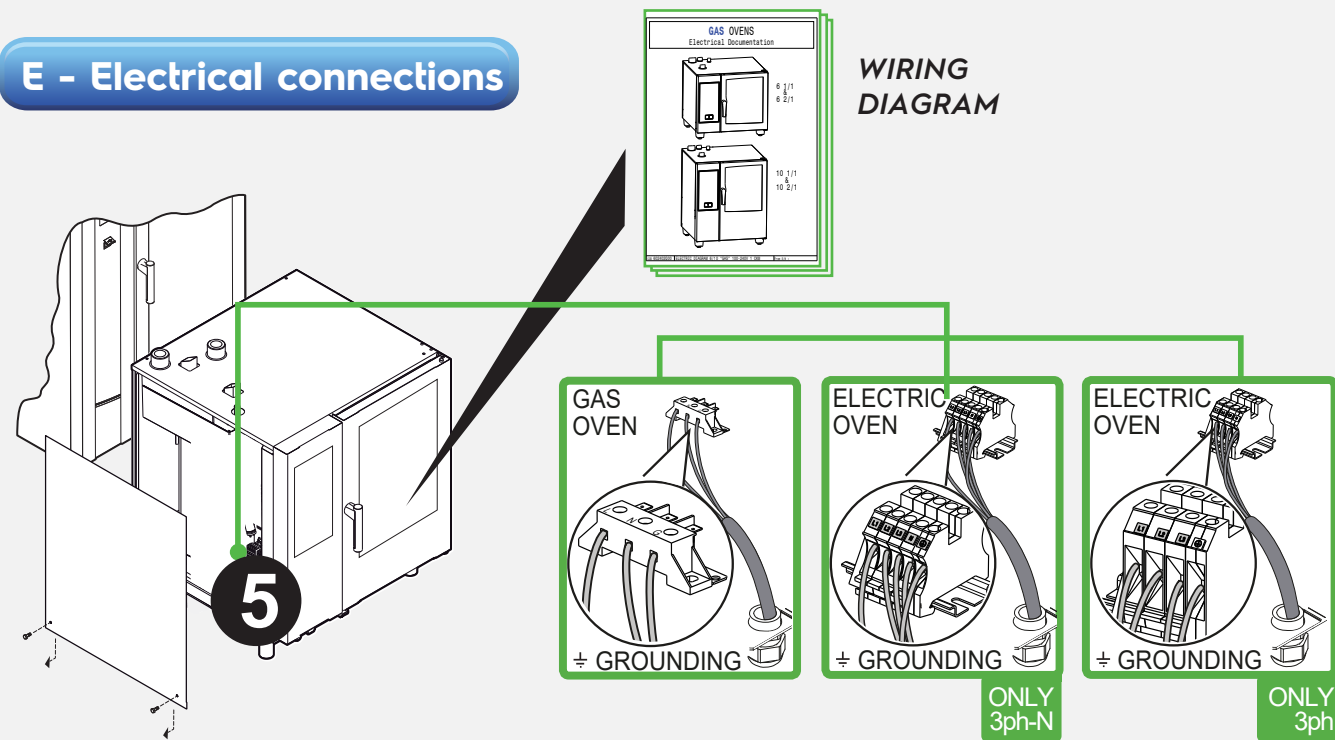

F - Positioning

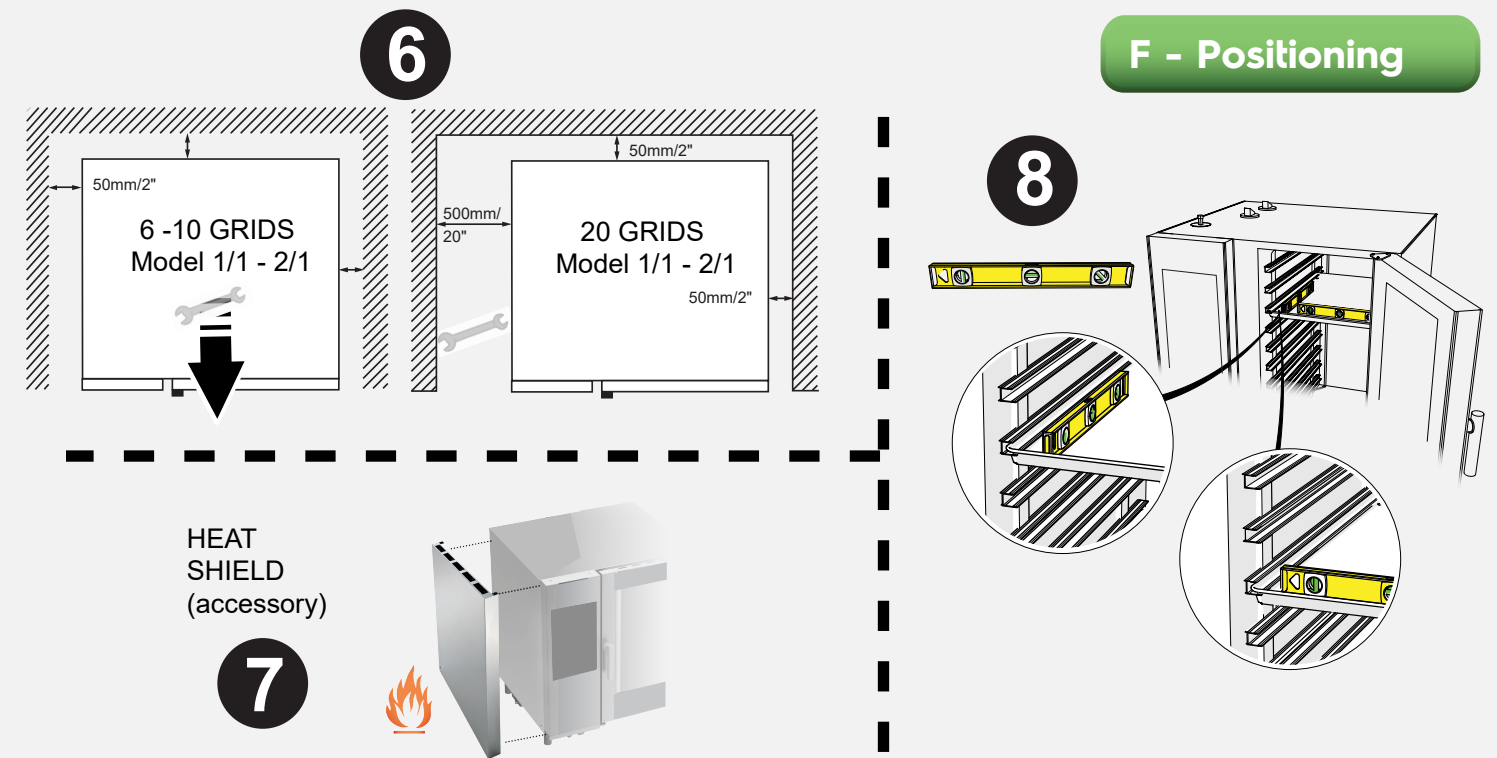


G - Set up

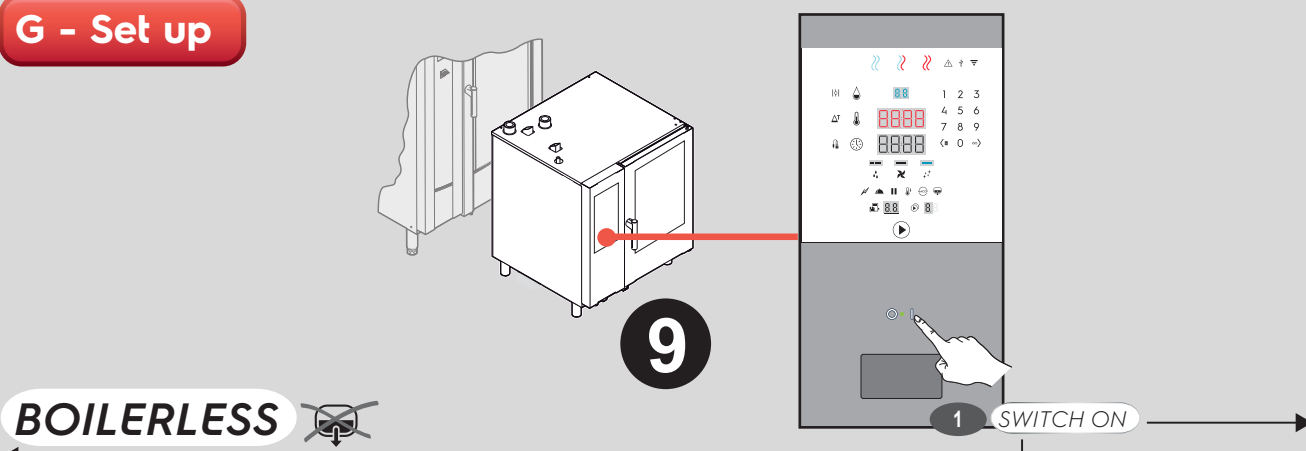


BOILER


A- CLEANING TEST

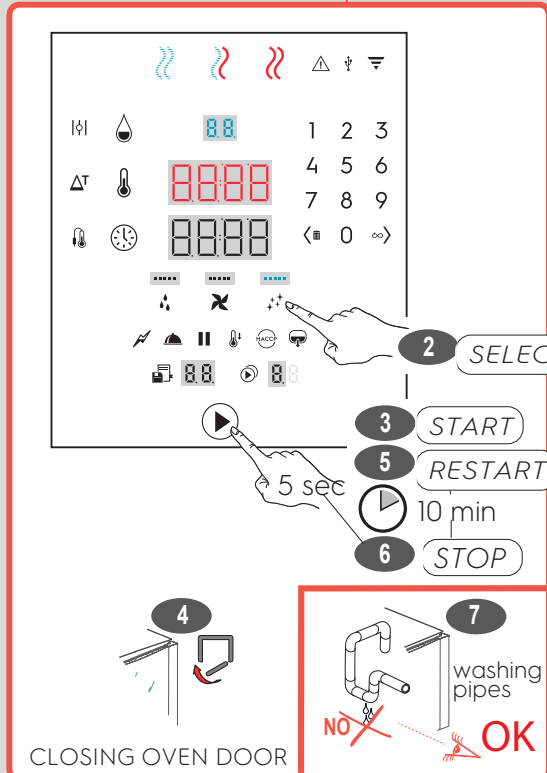


B- STEAM TEST

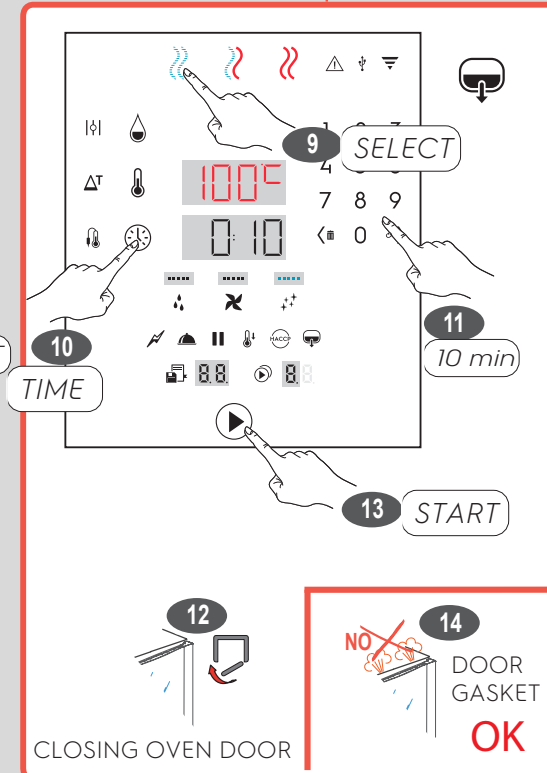

C- CONVECTION TEST

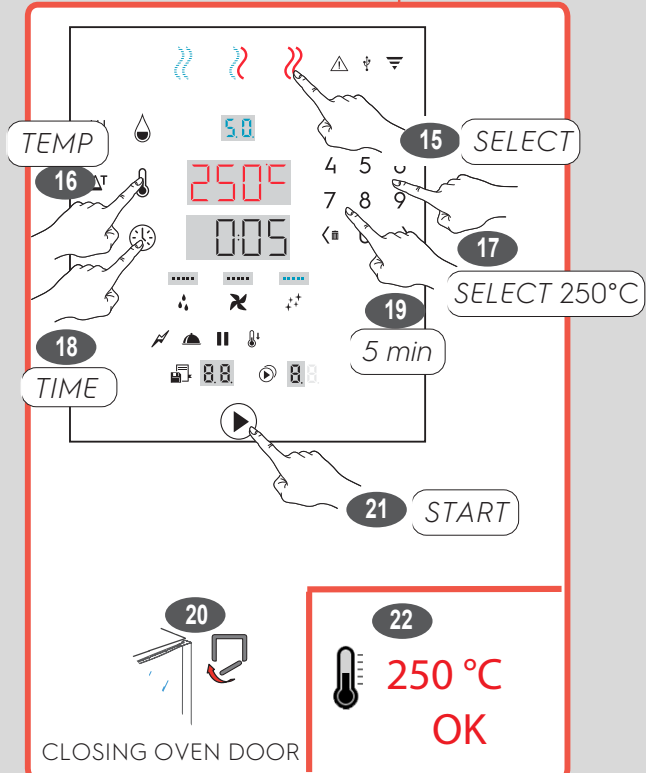

A- CLEANING TEST

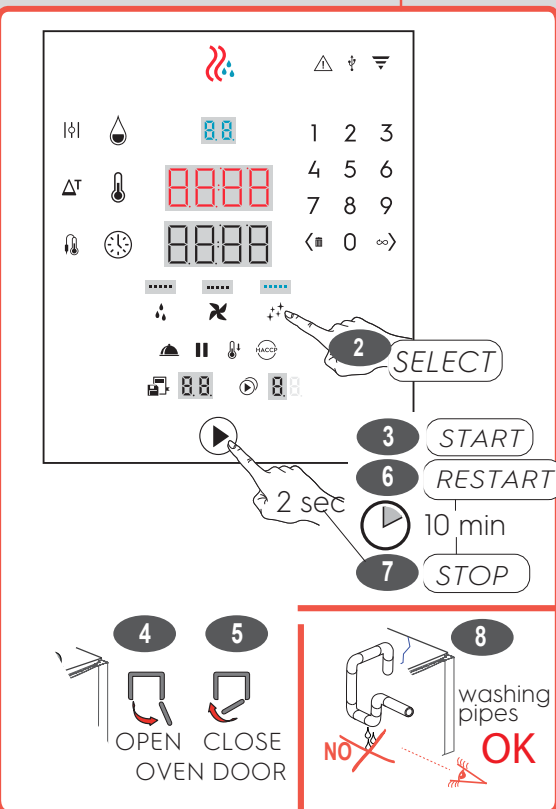

B- CONVECTION TEST

